



CONTRACTOR'S RESPONSIBILITY

- 1.1 CO-ORDINATE THE INSTALLATION OF ALL SERVICES WITHIN THE SUBDIVISION. ENSURE THAT THERE IS NO CONFLICT BETWEEN THE POSITIONING OF FULLY PRE-LAID WATER SERVICES AND ANY OTHER SERVICES AND SITE FACILITIES. THESE MAY INCLUDE WESTERN POWER UNDERGROUND POWER CONNECTION PILLARS, LIMESTONE RETAINING WALLS, DRAINAGE AND SEWER ACCESS CHAMBERS.
- 1.2 ENSURE THAT THE LOCATION OF PRELAID SERVICES SHOWN ARE NOT UNDER BRICK PAVED AREAS OR UNDER AREAS WHICH HAVE SPECIAL VERGE TREATMENT. WHERE THERE IS NO ALTERNATIVE TO LAYING SERVICES UNDER AREAS TO BE BRICK PAVED, THEN THE CONTRACTOR AT THE TIME OF MAIN LAYING, SHOULD SEEK INSTRUCTION FROM THE SUPERINTENDENT.
- 1.3 REPORT ANY DISCREPANCY OR CLASH WITH OTHER SERVICES TO THE SUPERINTENDENT.

NOTES

- 2.1 THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE CONTRACT DRAWINGS AND SPECIFICATION.
- 2.2 THE CONSTRUCTION OF THE WORKS SHALL COMPLY WITH THE WATER CORPORATION'S DESIGN STANDARD 'DS63'.
- 2.3 ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED.
- 2.4 THE MAINS SHALL BE LAID ON A 2.1m ALIGNMENT.
- 2.5 THE MAIN SHALL BE FULLY PRELAID UNLESS NOTED OTHERWISE.
- 2.6 ALL CONNECTIONS TO LIVE RETICULATION MAINS TO BE BY THE WATER CORPORATION AT THE CONTRACTORS EXPENSE.
- 2.7 FL AND FR INDICATES THE SIDE OF THE LOT WHEN VIEWED FROM THE ROAD FRONTAGE WHICH IS SELECTED FOR ITS METER LOCATION.

LEGEND


- EXISTING WATER MAIN
- PROPOSED WATER MAIN
- FUTURE WATER MAIN
- SERVICE CROSSING COMPLETE
- SERVICE CROSSING DUCT ONLY
- LOT TO BE SERVED FROM HIGH LEVEL MAIN
- CLOSED VALVE
- SLUICE VALVE
- HYDRANT
- CHANGE IN PIPE SIZE / MATERIAL
- FLUSHING POINT
- TEMPORARY BLANK END
- RETICULATION BOUNDARY
- DEFERRED SERVICE
- LOTS TO BE SERVED BUT NOT RELEASED IN THIS STAGE
- LOTS TO BE RELEASED BUT SERVED IN PREVIOUS STAGE
- RETAINING WALLS
- EXISTING TREE TO REMAIN

BEND TABLE	
	DENOTES DEFLECT PIPES
	DENOTES 11.25° C.I. BEND + D.P.
	DENOTES 22.50° C.I. BEND + D.P.
	DENOTES 45° C.I. BEND + D.P.
	DENOTES 90° C.I. BEND + D.P.
	DENOTES 90° P.E. BEND




MAINS AND SERVICES

3.1 CONSTRUCT MAINS OF:	
100P-16	- 486.4m
200P-16	- 305.0m
3.2 NUMBER OF SERVICES:	
PRELAID SHORT SINGLE	4
PRELAID SHORT DUAL	14
PRELAID LONG SINGLE	2
PRELAID LONG DUAL	11
SUB-TOTAL	31
DEFERRED SERVICE(S) BY WATER CORPORATION	0
TOTAL LOTS SERVED	56

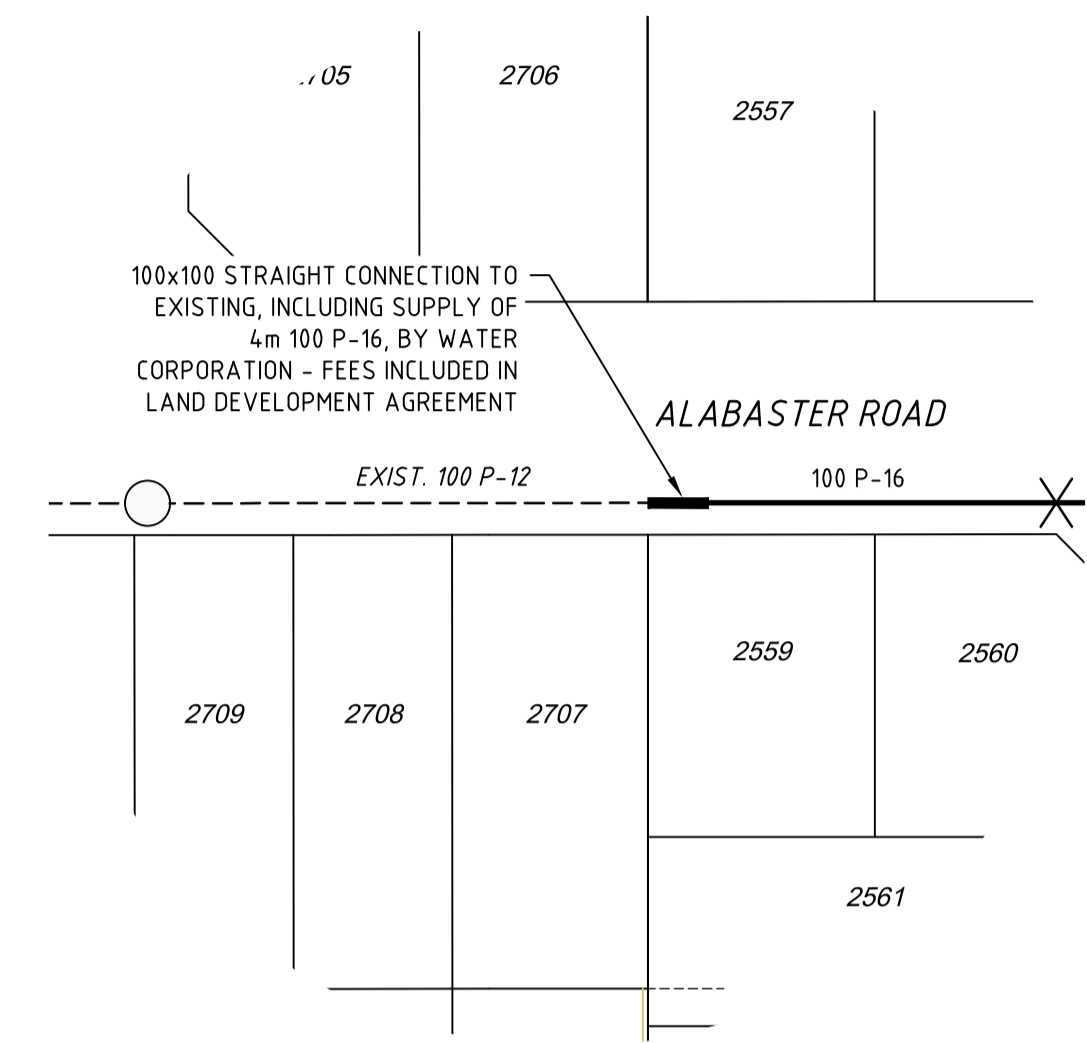

CONNECTION DETAIL 'A'
N.T.S.

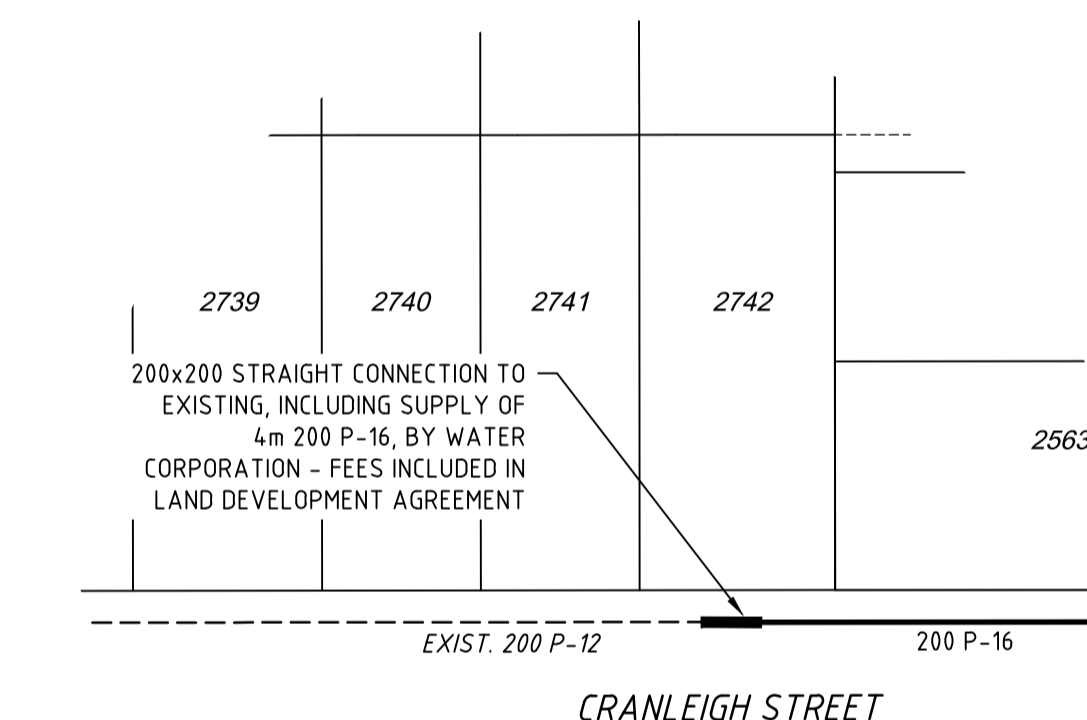

CONNECTION DETAIL 'B'
N.T.S.

FILE No: 122055709
PLAN: NU06-103-001-01A

MSWA RETICULATION SUBMISSION
 This plan is accepted as being in accordance with the endorsed Concept Plan: NT64-100-001
 Compliance with the relevant design standards and manuals remains the responsibility of the Design Engineer.
 No works are to commence on site until start-up meeting requirements have been made with the relevant Asset Inspector.
 Refer to the Developers' Manual for contact details.

WAPC No. 160731

SCALE 1:1000
A1

T:\Projects\2223\Design\CAD\Drawings\Stage 1\2223-1V-700.dwg 04/07/21 12:28:54 rev005

This plan shall not to be used for construction unless issued as rev O and signed as approved.

COPYRIGHT
 The concepts and information contained in this document are the Copyright of TABEC Pty. Ltd. Use or copying of the document in whole or part without the written permission of TABEC Pty. Ltd. constitutes an infringement of copyright.

CLIENT		DESIGNED		CHECKED		APPROVED	
PROGRESS DEVELOPMENTS		RDE	JZ	RDE	JZ	B. FARRELL	
ST LEONARDS		RDE	JZ	RDE	JZ	DATE 13.10.21	

TABEC
Civil Engineering Consultants

14 Wickham Street, East Perth WA 6004
08 9425 5900 info@tabec.com.au www.tabec.com.au

PROJECT		DRAWING NUMBER		ISSUE	
ST LEONARDS ESTATE, DAYTON - STAGE 1V		2223-1V-700		B	
TITLE		WATER RETICULATION PLAN			

No.	DATE	DRAWN	APPROVED	AMENDMENT	No.	DATE	DRAWN	APPROVED	AMENDMENT
B	13.10.21	RDE	JZ	ISSUED FOR APPROVAL.					
A	29.09.21	RDE	JZ	ISSUED FOR COMMENTS & PRICING.					